

Power quality analyzer

Possible measurements:

- Measurements according to EN 50160
- Voltage L1, L2, L3, N-PE (five inputs, compiles with EN 61000-4-30, class A)
 - average, minimum, maximum and instantaneous values, range to 690V, ability to work with voltage transducers,
- Current L1, L2, L3, N (four inputs)
 - average, minimum, maximum and instantaneous values, measurement current with range to 3kA (depends on used clamp), ability to work with current transducers,
- Crest factor for voltage and current,
- Frequency from 40Hz to 70Hz (compiles with EN 61000-4-30, class A),
- Active, reactive, distortion, apparent power, including the type of reactive power (capacitive, inductive),
- Power recording:
 - Budeanu method,
 - IEEE 1459,
- Active, reactive, apparent energy,
- Power factor, $\cos\phi$, $\tan\phi$,
- K factor (transformer overload caused by the harmonics),
- Up to 50th harmonics for voltage and current (compiles with EN 61000-4-7, class I),
- Total Harmonic Distortion (THD) for voltage and current,
- Short-term (P_{ST}) and long-term (P_{LT}) flicker (compiles with EN 61000-4-15, class A),
- Unbalance of Voltage (compiles with EN 61000-4-30, class A) and current,
- Voltage dips, swells and interruption registration including oscillograms (compiles with EN 61000-4-30, class A),
- Current events registration including oscillograms,
- Current and voltage oscillograms registration after each averaging period.



Standard accessories of PQM-701:

- clamp F-3 to 3kA AC ($\varnothing 214cm$),
- test lead with banana plugs; 2,2m; black (3 pcs.)
- test lead with banana plugs; 2,2m; yellow,
- test lead with banana plugs; 2,2m; blue,
- "Crocodile" clip K01; black (3 pcs.),
- "Crocodile" clip K02; yellow
- "Crocodile" clip K02; blue
- USB transmission cable,
- mains plug with banana inputs (L1 and N) for powering the device,
- WACEGF30KR
- WAPRZ2X2BLBB
- WAPRZ2X2YEBB
- WAPRZ2X2BUBB
- WAKROBL20K01
- WAKROYE20K02
- WAKROBU20K02
- WAPRZUSB
- WAADAAZ1
- Sonel Analysys software for data analysis,
- SD card,
- hard carrying case,
- mounting strap,
- DIN Rail Mounting Clip (ISO) (2 pcs)
- built-in rechargeable battery,
- instruction manual,
- calibration certificate.
- WAPOZSD1
- WAWALX1.1
- WAPOZOPAKPL
- WAPOZUCH2

Specification		Range	Resolution	Accuracy
AC voltage (TRMS)	-	0,0...690,0V	0,01 % U_n	$\pm 0,1\% U_n$
Crest Factor	Voltage	1,00...10,00 ($\leq 1,65$ for voltage 690V)	0,01	$\pm 5\%$
	Current	1,00...10,00 ($\leq 3,6 I_{nom}$)	0,01	$\pm 5\%$ m.v.
AC current TRMS	-	depends on the clamp*	0,01 % of nominal range	$\pm 0,1\%$ of nominal range (add clamps accuracy)
Frequency	-	40,00...70,00 Hz	0,01Hz	$\pm 0,01$ Hz
Active, reactive, apparent power and distortion	-	depends on configuration (transformers, clamp)	up to 4 decimal places	depends on configuration (transformers, clamp)
Active, reactive and apparent energy	-	depends on configuration (transformers, clamp)	up to 4 decimal places	the same as above
$\cos\phi$ and Power Factor (PF)	-	0,00...1,00	0,01	$\pm 0,03$
$\tan\phi$	-	0,00...10,00	0,01	depends on Active and Reactive power accuracy
Harmonics	Voltage	same as for AC voltage TRMS	same as for AC voltage TRMS	$\pm 5\% U_n$ for $U_n \geq 1\% U_n$ $\pm 0,05\% U_n$ for $U_n < 1\% U_n$
	Current	same as for AC current TRMS	same as for AC current TRMS	$\pm 5\% I_n$ for $I_n \geq 3\% I_n$ $\pm 0,15\% I_n$ for $I_n < 3\% I_n$
Total Harmonics Distortion	Voltage	0,0...100,0%	0,1%	$\pm 5\%$
	Current			$\pm 5\%$
Harmonics active and reactive power	-	depends on configuration (transformers, clamp)	depends on current and voltage minimum value	-
Angle between voltage and current harmonics	-	-180,0...+180,0°	0,1°	$\pm (h \times 1^\circ)$
K-Factor	-	1,0...50,0	0,1	$\pm 10\%$
Flicker	-	0,20...10,00	0,01	$\pm 5\%$
Unbalance	Voltage and current	0,0...20,0%	0,1%	$\pm 0,15\%$ (absolute error)

*Clamp F-1/F-2/F-3: 0..3000A (10000Ap-p) *Clamp C-4: 0..1000A (3600Ap-p) *Clamp C-5: 0..1000A (3600Ap-p) *Clamp C-6: 0..10A (36Ap-p) (without current transducers)

Power quality analyzer

Sonel Analysis 1.0

„SONEL Analysis” software is an application used to work with PQM-701 power quality analyzer. It enables:

- analyzer configuration,
- reading data from the analyzer,
- network parameters check in real time,
- data deleting in the analyzer,
- data presentation in tables,
- data presentation in diagrams,
- data analysis according to EN 50160 or according to user defined conditions,
- independent service of multiple analyzers,
- software upgrade through the Internet.




Analyzer configuration

The software enables configuration of all analyzer's parameters. The configuration is made on the PC computer and later transferred to the analyzer. The configuration settings can be stored on hard drive or other data storage devices to be used later. The software enables the configuration of:

- the choice of Measurement Points and memory assignment to each Measurement Point,
- analyzer time settings,
- keyboard lock,
- PIN code security,
- averaging time setting,
- choice of current and voltage transformers,
- trigger mode choice (immediately, after an event or according to the scheduler),
- choice of clamp's type, setting of additional parameters registration in N and PE channels,
- choice of network type, for which the analyzer will be used.


The analyzer has four independent Measurement Points. Each Measurement Point can be set individually to perform four different types of registration without need

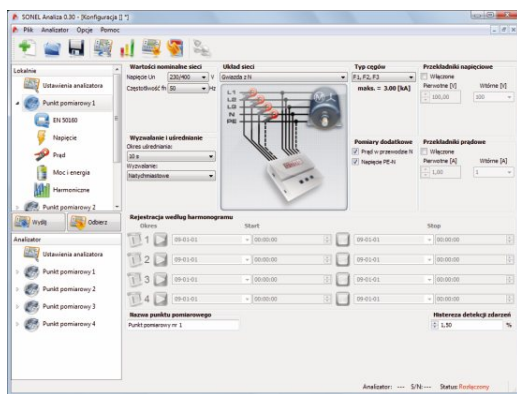

to change analyzer's configuration.

For each Measurement Point the following settings can be made:

- whether the analyzer shall work according to EN 50160 or according to user defined conditions,
- for each registration user can define, which network parameters shall be registered,
- for each parameter user can define whether the analyzer shall register average, minimum, maximum or instantaneous values,

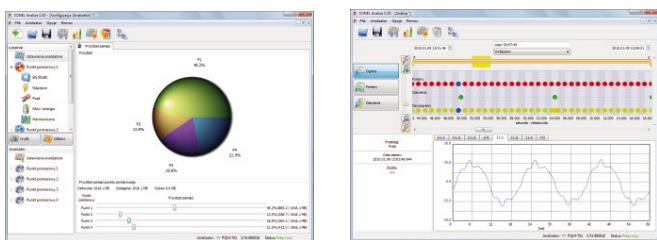

- the limits beyond which the analyzer will record the event can be defined.

Recent data reading

“SONEL Analysis” software enables reading of selected parameters and their graphic presentation in real time. These parameters are measured independently of the registration saved on the memory card. User can check:


- voltage and current diagrams (oscilloscope),
- diagrams of voltage and current in time function,
- scope phasor,
- different parameters values,



- harmonics and harmonics' power.

Data analysis


With “SONEL Analysis” software user can read data stored on the memory card and analyze them. Data from the analyzer can be stored on hard drive and be used

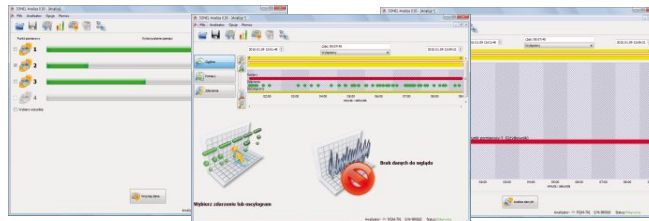

later. This feature enables data archiving.

The user can analyze the data from the device. There is a choice of:

- **General** – all data are shown with dots (Measurements, Events and Oscillograms),
- **Measurements** – all measured values registered in averaging time are shown with dots (voltage, frequency, etc.),
- **Events** – all detected events are shown with dots (dips, swells, interruptions,

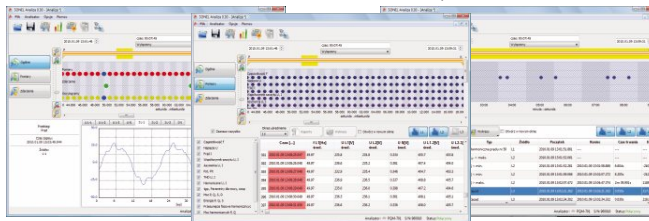

etc.).

The software enables different types of diagrams, which show in a simple way the registered data:

- **Time diagram** – graphs of indicated parameters in time function,
- **Oscillograms** – graphs of instantaneous voltage and current during an event or at the end of averaging time,
- **Harmonics diagram** – bar graph showing harmonics from 1 to 50,



With data from the analyzer user can prepare reports, which can be saved on the hard drive in PDF, HTML or TXT files.

The software enable to prepare the report according to EN 50160 standard.